




# Pool-1-d.-Tester



pH (Phenol Red)  
 CHLORINE • CHLOR • CHLORE  
 CHLOOR • KLOR • CLORO (DPD1/DPD3)




pH (Phenol Red)  
 O<sub>2</sub> (DPD4)




Pool-1-d.-Tester  
**MINI-Tester**

pH (Phenol Red)  
 CHLORINE • CHLOR • CHLORE  
 CHLOOR • KLOR • CLORO (DPD1/DPD3)




pH (Phenol Red)  
 O<sub>2</sub> (DPD4)

**1**

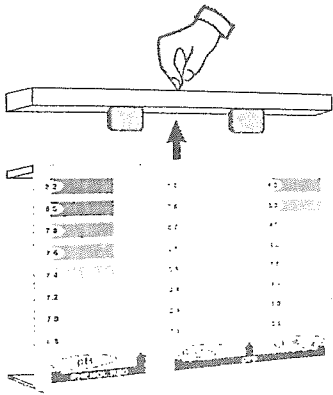


**3**

Phenol Red RAPID      chlorine\*: DPD1 RAPID  
 O<sub>2</sub>: DPD4 RAPID

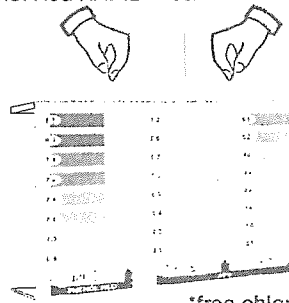


\*free chlorine = DPD1  
 total chlorine = DPD1 + DPD3


**5**

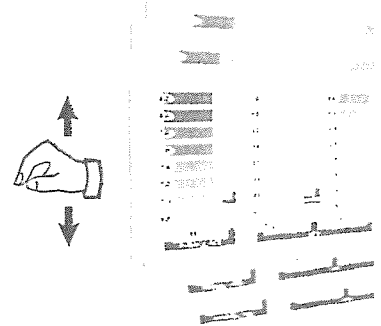

**2**

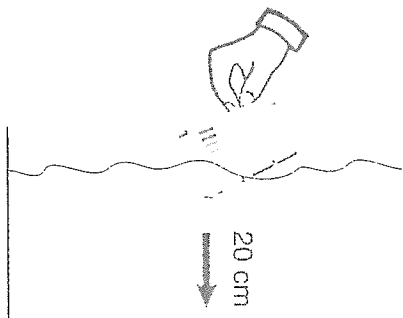


**4**

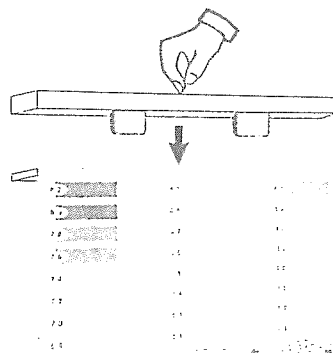

**6**

Ideal:  
 pH 7,0 - 7,4

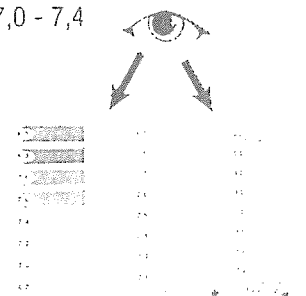

**(GB)**

## CAUTION!

Reagents for water-analysis only!  
 Do not eat! Keep away from children!  
 Store cool and dry!  
 Clean tester properly before testing!

**(F)**

## Attention!

Les comprimés pour l'analyse de l'eau,  
 sont destinés exclusivement aux  
 analyses chimiques! Ne pas ingérer!  
 Tenir hors de portée des enfants.  
 Conserver au frais et au sec.  
 Bien rincer le testeur avant chaque utilisation.

**(E)**

## Atención!

Pastillas para el análisis des agua,  
 solamente para análisis químicos!  
 No para tomar!  
 No debe llegar a las manos de niños!  
 Consérvese en lugar fresco y seco!  
 Limpiar el aparato antes de usar!

**(D)**

## Achtung!

Wasseranalysetabletten nur für  
 chemische Anlaysen! Nicht einnehmen!  
 Darf nicht in die Hände von Kindern gelangen!  
 Kühl und trocken lagern!  
 Testgerät vor Gebrauch gründlich reinigen!

**(I)**


## Attenzione!

Reagenti unicamente per analisi acqua!  
 Non ingerire!  
 Tenere fuori dalla portata dei bambini!  
 Mantenere in luogo asciutto e fresco  
 Dopo l'utilizzo pulire ed asciugare  
 accuratamente il tester



72310

# REFILL

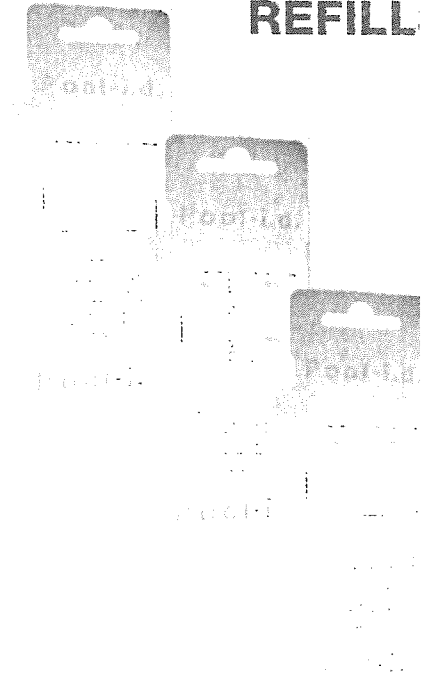

TbsRD1pH60 30 pH + 30 DPD1

TbsRD3pH60 30 pH + 30 DPD3

TbsRD4pH60 30 pH + 30 DPD4

JUST THE BETTER POOL!